
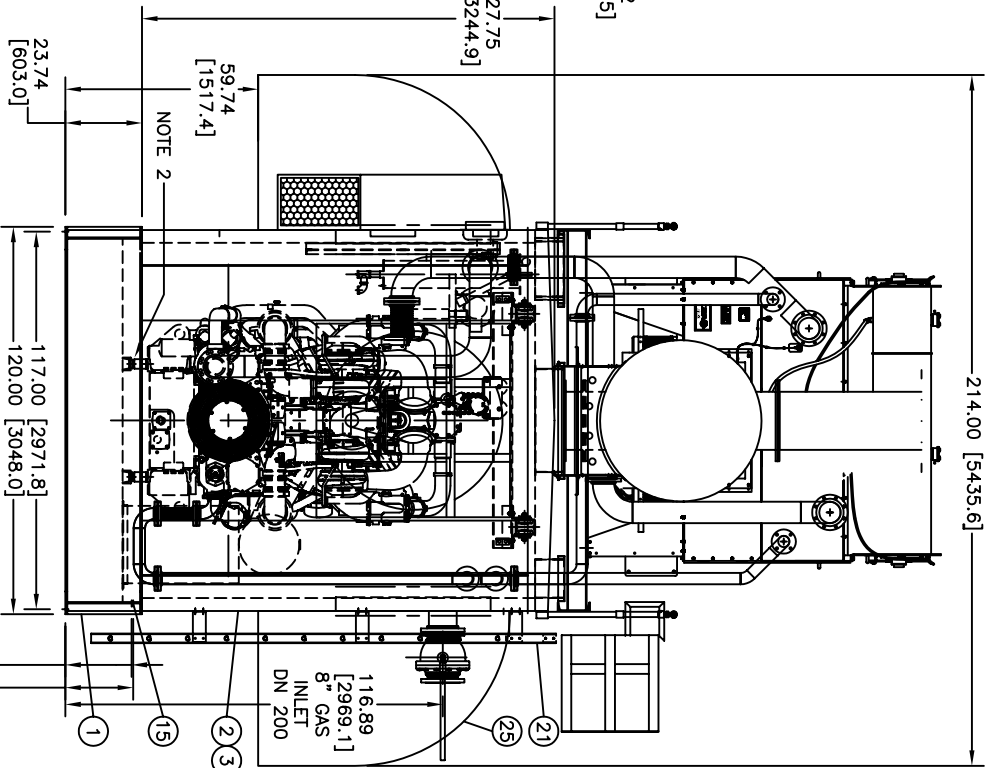


07-16468			CDOB00ACC0IG42	
COMP	QTY	DESCRIPTION		
1	1	STRUCTURAL BASE WITH (6) POINT LIFT PROVISIONS AND FULL STEEL FLOOR		
2	1	ENCLOSURE 118W X 504L X 128H WITH (4) GASKETED LOCKABLE ACCESS DOORS AND INSIDE OPERATORS		
3	1	SOUND INSULATION WITH GALVANIZED PERFORATED LINER		
4	2	MOTORIZED INTAKE LOUVER WITH SCREEN		
5	1	VENTILATION FAN WITH INTAKE GUARD AND GRAVITY DAMPER		
6	1	EXHAUST FLEX CONNECTION AND ROOF DRESS CAP		
7	4	EXHAUST SILENCER MOUNTING BRACKETS		
8	1	TRANSFORMER 480:208/120 THREE PHASE		
9	1	PANELBOARD 480V THREE PHASE		
10	1	PANELBOARD 208/120 THREE PHASE		
11	1	FLUORESCENT LIGHTS 120VAC WITH (3) WALL SWITCHES		
12	6	GFI PROTECTED DUPLEX RECEPTACLES		
13	3	CO2 FIRE SUPPRESSION SYSTEM COMPLETE WITH AGENT TANKS		
14	1	DISCHARGE NOZZLES A MANUAL RELEASE STATION CONTROL PANEL HEAT DETECTORS AND ALARM STROBE		
		OIL AND WATER DISPOSAL GROUP		
15	1	SPACE HEATER 5KW WITH A THERMOSTAT		
16	1	3 TON AIR CONDITIONER WITH LOW AMBIENT CONTROLS *		
17	1	30 GALLON LUBE OIL RESERVOIR TANK AND LEVEL REGULATOR		
18	1	SUMMER EXHAUST FAN		
19	1	MANUAL OVERHEAD CHAIN HOIST 2200LB CAPACITY		
20	1	ROOF ACCESS LADDER WITH HANDRAILS (OPTIONAL EQUIPMENT) *		
21	1	AFTERCOOLER PIPING *		
22	1	JACKETWATER PIPING *		
23	1	EXHAUST SILENCER 18" HOSPITAL GRADE SPARK ARRESTOR *		
24	1	INTAKE HOOD WITH SCREEN *		
25	2			

* ITEM SHIPS LOOSE TO BE SET AND
INSTALLED BY CONTRACTOR ON SITE

214.00 [5435.6]

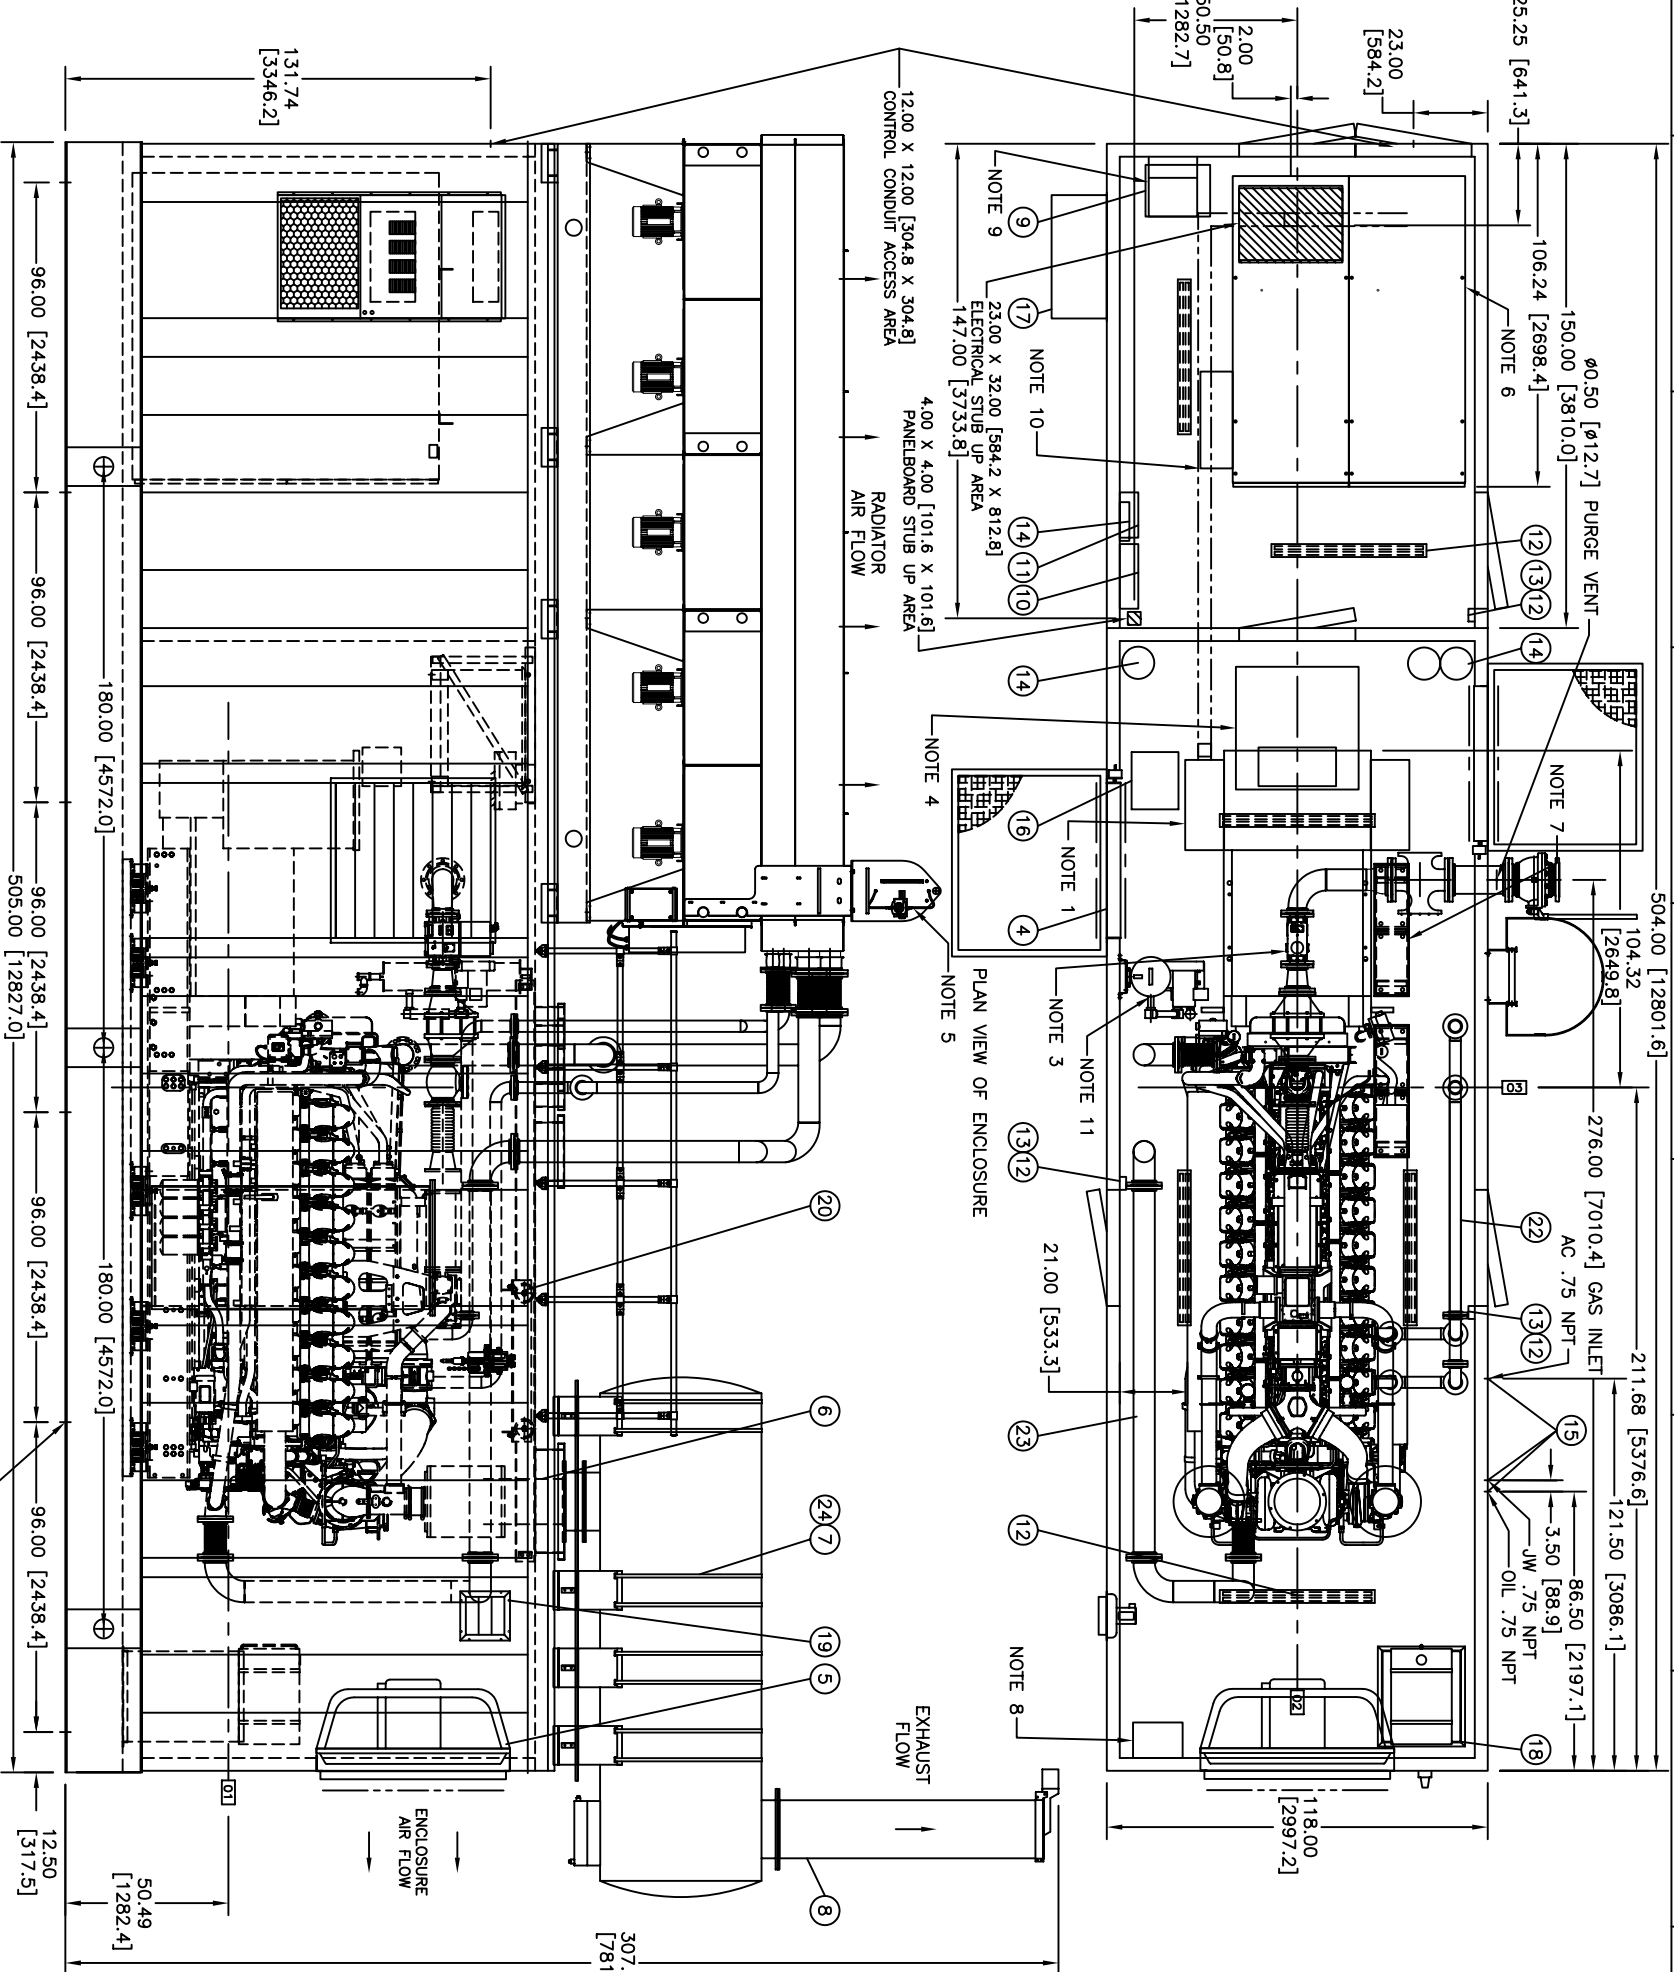

FRONT VIEW 20.50 [520.7] AC
21.00 [533.4] JW/OIL

ENCLOSURE PACKAGE FOR CAT G3520C GEN SET

THIS PRINT IS THE PROPERTY OF CHILICOthe Metal Co. 4507 E. ROUTE ROAD CHILICOTHE, IL. 61523 USED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF CHILICOthe Metal Co. IS PROHIBITED. DRAWING NO. 07-16468 DATE 11/8/07 ENGR. FILED CD		CHILICOthe Metal Co.	
REV	DATE	BY	DESCRIPTION OF CHANGE
1	11/21/07	AW	PURGE VENT/ADD LIGHT SWITCH
2	12/11/07	CT	REWORKING
3	12/11/07	CT	REWORKING
4	12/11/07	CT	REWORKING
5	12/11/07	CT	REWORKING
6	12/11/07	CT	REWORKING
7	12/11/07	CT	REWORKING
8	12/11/07	CT	REWORKING
9	12/11/07	CT	REWORKING
10	12/11/07	CT	REWORKING
11	12/11/07	CT	REWORKING
12	12/11/07	CT	REWORKING
13	12/11/07	CT	REWORKING
14	12/11/07	CT	REWORKING
15	12/11/07	CT	REWORKING
16	12/11/07	CT	REWORKING
17	12/11/07	CT	REWORKING
18	12/11/07	CT	REWORKING
19	12/11/07	CT	REWORKING
20	12/11/07	CT	REWORKING
21	12/11/07	CT	REWORKING
22	12/11/07	CT	REWORKING
23	12/11/07	CT	REWORKING
24	12/11/07	CT	REWORKING
25	12/11/07	CT	REWORKING

- NOTES:
- CAT G3520C 1600KW LA-4310 GEN SET SHOWN WITH 866 FRAME GENERATOR RH AND LH CABLE ACCESS BOX
 - CAT VIBRATION ISOLATORS SHOWN
 - DUNGS GAS TRAIN SHOWN (SEE SHEET 2)
 - MILWAUKEE RESISTOR NGR SHOWN PER DWG #NG0246 (OPTIONAL EQUIPMENT)
 - IEA HORIZONTAL CORE RADIATOR SHOWN PER DWG #HCR-M140-05-22-S01 REV. C2
 - POWERLYNX SWITCHGEAR CUBICLE SHOWN PER DWG #35925 REV. 0.1
 - CAT BATTERIES RACKS AND CABLE GROUP
 - ENGINE STARTING BATTERY CHARGER SHOWN
 - BREAKER CONTROL BATTERY CHARGER SHOWN
 10. BREAKER CONTROL 48VDC BATTERIES RACK AND CABLES SHOWN
 - CAT CRANKCASE BLOWER SHOWN
 12. APPROXIMATE WEIGHT OF ENCLOSURE PACKAGE = 107,000 LB
 13. RECOMMEND MINIMUM OF 60.00 [1524.0] BETWEEN THE ENCLOSURE AND ANY OTHER STRUCTURE FOR PROPER VENTILATION.
- REFER TO LOCAL CODE AND/OR ORDINANCE FOR ANY FURTHER RESTRICTIONS.

RIGHT SIDE VIEW

1.12 [28.45] DIA MTG HOLE
(6) PLACES EACH SIDE
CONCRETE PAD ATTACHMENT POINTS

EST. SHIPPING DIMENSIONS
WIDTH - 130.00 [3302.0]
HEIGHT - 157.00 [3987.8]
LENGTH - 514.00 [13055.6]